

Ref No : PUR/IMP/GT/SK/HESP/01/15-16.

April 10, 2015.

Dear Sir/s,

The Director, Indian Institute of Astrophysics, Bengaluru, invites Sealed Tenders Two bids system (Technical bid & Commercial bid) for the Supply of **“Chiller unit with accessories”** as per our specifications in ‘Annexure - B’. The terms and conditions may be noted from IIA Website and if you are in a position to quote for the supply in accordance with the requirements, please submit your quotation. The Tender documents and other details are available on IIA web site www.iiap.res.in/tenders.htm

The Tender bids must be in Foreign currency quote. Your completed Tender bids both Technical and Commercial bid (**2 Bids system**) must reach our office on or before 20/05/2015 by 15 00 hrs. The bids must be in a separate Sealed envelopes duly superscribed with the name of the supply, Due Date and the envelopes kept in a big envelopes mentioning the supply, must reach this Office within the Due Date and time. The Technical bids (a) will be opened in the presence of bidders or their authorized representative of the Company by 15.30 hrs on 20/05/2015. The commercial bids will be opened only for those vendors quotes qualify in Technical evaluation. The opening of commercial bids, date end time will be intimated later. Incomplete Bids are liable for rejection.

For any Technical clarifications you may contact during Office hours Mr. S. Kathiravan (Phone No.2254 1403) and for any commercial clarifications can contact Stores & Purchase Officer (Phone No.2254 1244).

Thanking you,

Yours faithfully,

Y.K.Raja Iyengar
Stores & Purchase Officer

GLOBAL TENDER DOCUMENT No : PUR/IMP/GT/SK/HESP/01/15-16.

DT : 10/04/2015.

TENDER FORM

FROM:

TO

THE DIRECTOR
Indian Institute of Astrophysics,
Bangalore - 560 034.

Sir,

I/We hereby offer to supply the Items/Equipment indicated below at the price hereunder quoted and agree to hold this office open till . I/We shall be bound to supply the items/Equipment hereby offered upon the issue of the Purchase Order communicating to the acceptance thereof on or before the expiry of the last mentioned date. You are at liberty to accept any one or more of the items such Items/Equipment. I/We not withstanding that the offer in this tender has not been accepted in whole, shall be bound to supply such items and such portion or portions of one or more of the items as may be specified in the said Purchase order communicating the acceptance.

-

S No.	Description of the item(s)	Qty.	Unit	Rate	Dely. Period
-------	----------------------------	------	------	------	--------------

-

1. Chiller Unit with accessories for HESP Thermal Control as per the Specifications and RFP attached in Annexure B . 01 Set

(Two bid system, both Technical bid and commercial / price bid should be submitted separately)

Tender bids should be Foreign currency quote.

-

Place at which the Delivery is required : Indian Institute of Astrophysics, CREST Campus, Sidalagatta Raod, Hosakote – 567114

Date by which the supplies are required : 4 weeks from the date of order.

I/We have understood the items of the tender annexed to the invitation to the Tender and have thoroughly examined the specifications/drawing and / or pattern quoted or referred to herein and / are fully aware of the nature of the items/ Equipment required and my / our offer is to supply the items/ Equipment strictly in accordance with the requirements subject to the terms and

conditions contained in the Purchase order communicating the acceptance of this tender either in whole or in part.

Date :

Signature and Seal of Supplier

Annexure - A

INSTRUCTIONS TO SUPPLIERS

1. Tenders should be sent in a sealed envelopes with both Technical bid and commercial bid in separate envelopes and superscribed by mentioning of Tender Number, date and date of opening. Only one Tender should be sent in each envelope. Tender bids must reach our Office on or before : 20/05/2015 by 15:00 hrs.
2. Late and Delayed tender will not considered at all.
3. Duties, Taxes where legally leviable and intended to be claimed should distinctly shown separately in the Tender.
4. a) Your quotation should be valid for 90-120 days from the date of opening of Tender.
b) Prices are required to be quoted according to the units indicated in the annexed tender form. When quotations are given in terms of units other than those specified in the Tender form, relationship between the two sets of units must be furnished.
5. a) All available Technical Literature(s), Catalogue(s) and other data in support of the specifications and details of the item(s) should be furnished along with the offer.
b) Approximate net and gross weight of the items offered shall be indicated in your offer. If dimensional details are available the same should indicated in your offer.
c) Air freight/sea freight charges up to IIA, Bangalore/ Bangalore Airport may be sent along with the offer.

d) Specifications:

Items / Equipment offered should strictly conform to our specifications. Deviation, if any should be clearly indicated by the Supplier in their quotation. The supplier should also indicate the Make / type No. of the stores offered and provide catalogue(s), Technical literature(s) and sample(s), wherever necessary along with the quotations. Test certificates wherever necessary should be forwarded along with the supplies. Whenever options are called for in our specifications, the Supplier should address all such options. Wherever specifically mentioned by us, the Supplier could suggest changes to specifications with appropriate response for the same.

1. Corrections, if any, must be attested. All amounts shall be indicated both in words as well as in figures. Where there is difference between amounts quoted in words and figures, amount quoted in words shall prevail.
2. The supplier should supply along with the tender, the Banking information for payment or any other purpose.
3. A complete set of instruction and operation manual should be supplied.
4. Final performance should be guaranteed.

TERMS AND CONDITONS OF CONTRACT

1. DEFINITIONS:

—

- a) The terms 'Purchaser' shall mean the Director, Indian Institute of Astrophysics, Bangalore - 560 034.
- b) The term 'Supplier' shall mean, the person, firm or company with whom or with which the order for the supply of Items / Equipment is placed.
- c) The terms 'Purchase Order' shall mean the communication signed on behalf of the Purchaser by an officer duly authorized intimating the acceptance on behalf the Purchaser on the terms and conditions mentioned or referred to in the said communications accepting the tender or offer of the supplier for supply of Items/Equipment.

2. PRICES:

The price may please be indicated on unit basis only.

Duty Exemption:

Please note that we may issue "Customs duty Exemption Certificate & Excise duty exemption certificate" under the Govt. of India notification No.51/96 & No.10/97 valid till 2016.

3. GUARANTEE AND REPLACEMENT:

The Supplier shall guarantee that the Items/Equipment supplied shall comply fully with the specifications laid down, for material workmanship and performance. The Guarantee should be for a period of one year minimum from the date of supply.

4. PACKING, FORWARDING AND INSURANCE:

The Contractor will be held responsible for the stores being sufficiently and properly packed for transport by air / Sea to withstand transit hazards ensure safe arrival at the destination. The packing and marking of packing shall be done by and at the expenses of the contractor. The Purchaser will not pay separately for transit insurance, all risks in transit being exclusively of the supplier and the Purchase shall pay only for such Items/Equipment as are actually received in good condition, in accordance with contract.

5. **TEST CERTIFICATE:**

Wherever required Test Certificate should be sent before dispatch of the items.

6. **ACCEPTANCE OF ITEMS / EQUIPMENT:**

a)It is expressly agreed that the acceptance of Items/Equipment, is subject to final approval by the Purchase, whose decision shall be final.

7. **DELIVERY PERIOD:**

Delivery is the essence of the contract. The supplier should adhered to delivery schedule as indicated in the Purchase order.

8. **EXTENTION OF DELIVERY TIME:**

As soon as it is apparent that Supplier dates cannot be adhered to, an application shall be sent by the Supplier to the Purchaser. If failure, on the part of the Supplier to deliver the Items/Equipment in proper time shall have arisen from any cause which the Purchaser may admit as reasonable ground for an extension of the time (and his decision shall be final he may allow such additional time as he considers it to be justified by the circumstances of the case). In case of Letter of Credit the banking charge for the LOC amendment will be on suppliers account.

9. **PAYMENT:**

Preference will be given to the supplier whose payment terms is on Site Draft or Credit basis.

10. **SECURITY FOR PAYMENT:**

Successful Supplier will have to furnish in the form of a Bank Guarantee or any other form as called for by the Purchase towards any payments before supply of items/equipment. In case of payment through Letter of Credit the Banking charges outside India and inside India will be on suppliers account.

11. IIA reserves the right to reject any or all the Tenders without assigning any reason.

Annexure : B -

Chiller RFP for HESP Thermal Control

Site Conditions:

- ⇩ The seasonal temperature variation of Hanle is around -30 °C to +30°C
(Ambient air temperature).
- ⇩ The day/night variation is 10°C median (over a year) 15°C max (over a year)
- ⇩ Monthly variation is 3°C (median over the year)
- ⇩ Minimum temperature inside the dome = -15 Deg C
- ⇩ Maximum Temperature inside the doom = + 25 Deg C
- ⇩ Minimum temperature inside the PUF enclosure = -13Deg C
- ⇩ Maximum temperature difference expected between ambient and set point = 46C
- ⇩ Atmospheric pressure: 56% of that at mean sea level.
- ⇩ Altitude of installtion: 4500m above mean sea level.
- ⇩ Ambient humidity variation over a year: 5% to 95% RH (Non-condensing).
- ⇩ Latitude, Longitude : 32° 47' 26.9088" N & 79° 0' 0.7992" E

Yearly Temperature variation:

The temperature variation over the year 2013-2014 is given in Fig #1. The blue line represents the temperature measured at inside the outer enclose and the green colour i.e. weather station represents the ambient temperature outside the dome.

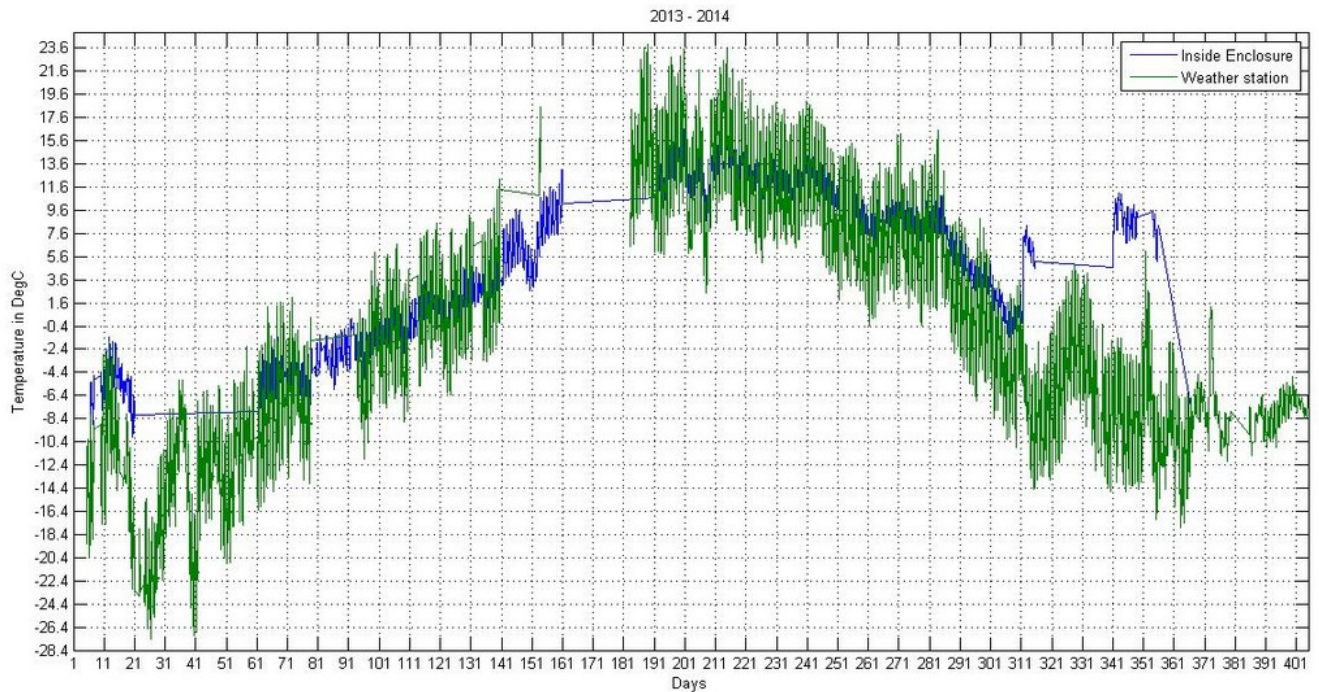


Fig #1

Chiller Requirements:

The chiller shall be suitable to work for the above site conditions

Chiller with air-cooled refrigerating unit and circulation pump (industrial plastic material). Housing, atmospheric open expansion tank and copper soldered evaporator made of stainless steel with digital level indicator for externally closed applications with adjustable over temperature protection.

We prefer to use DI water is mixed with either glysantine or ethylene glycol for freeze protection.

Temperature range for the brine solution : -10 ... +100 °C

Cooling capacity : 4 kW

100% of rated cooling power upto +35°C

Cooling power 4 kW with possibility to limit cooling power % (example : 30 %, 40 %.. as max applicable cooling power %)

Heating Capacity : 4kW

Heating power 4 kW with possibility to limit heating power % (example : 30 %, 40 %.. as max applicable heating power %)

Temperature stability : +/- 0.1 Deg C
Pressure pump max. : 26 l/min / 3.0 bar

Pump connection : G3/4 male

Volume of expansion : 3.5 L

Internal temperature sensor : Pt100

Sensor external connection : Pt100

External sensor Pt 100 with 5 mtr cable and required interface to the controller shall be provided.

The aid cooled unit shall have the ventilator fan's outlet preferably on top so that a ducting can be made and extended to leave the hot air to outside atmosphere. The specifications of the ventilator fan shall be provided so that equivalent capacity/suitable exhaust fan will be employed at the other end of duct to exhaust hot air to the surrounding.

Power supply : 400V 3~N 50Hz /220V-50Hz
Interface : Digital Ethernet, USB (Host USB), RS232

The controller shall have pioneering technology and advanced control functions to bring numerous advantages to routine work. The features list shall include a TFT touch screen display, USB and network connections, an integrated technical glossary and language support
The USB port shall allow connection of the system to a PC or notebook. Together with the analysis software, requirements such as remote control or data transmission shall be easily achieved in a cost-effective manner. Network integration shall be easy with the internet port.
TAC (True Adaptive Control) - self optimising internal and cascade control, selectable temperature control mode (Internal/Process), programmer with multiple programs , ramp function (linear), 5 point calibration, scalable graphic display, favourites menu, display resolution 0,01 K, required software, etc., shall be required.

System shall be delivered with remote control, operating panel connected via 25mtr cable. The required software shall be provided to

Protection class: IP54 - Electrical Compartment with integrated cooling & heating **Max Ambient Temp +35Deg.c**

The interface details to the AHU cooling/Heating coil shall be provided. The AHU cooling coil dia is approximately ½”.

Installation at Hanle (Jammu & Kashmir), connection between AHU and chiller by suitable insulated plumbing shall be included in the offer.

Detailed drawing to be made and shall be approved by IIA before execution.